

P43 PROGRAMMABLE TRANSDUCER OF 3-PHASE POWER NETWORK PARAMETERS

Features

- MOD BUS
- RTC
- LPConfig Program
- P, Q
- C/L
- L/C

Input



Outputs

- 20...20 mA
- RS 485
- USB


Galvanic Isolation

- Supply
- RS 485



- Measurement and conversion of power network parameters in 4-wire balanced or unbalanced systems.
- Tetraquadrantic energy measurement (Ep+, Ep-, EQL, EQc).
- Measurement of 15, 30 or 60 minutes' mean active power (synchronization by an internal clock or a walking window) with the archiving function of 1000 last samples.
- Programmable current and voltage transformer ratios.
- Programmable parameters through the RS-485 interface or USB when using the free LPCon program.
- RS-485 communication interface with MODBUS protocol.
- Detection and signalling of incorrect phase sequence.
- THD measurement.

Example of Application

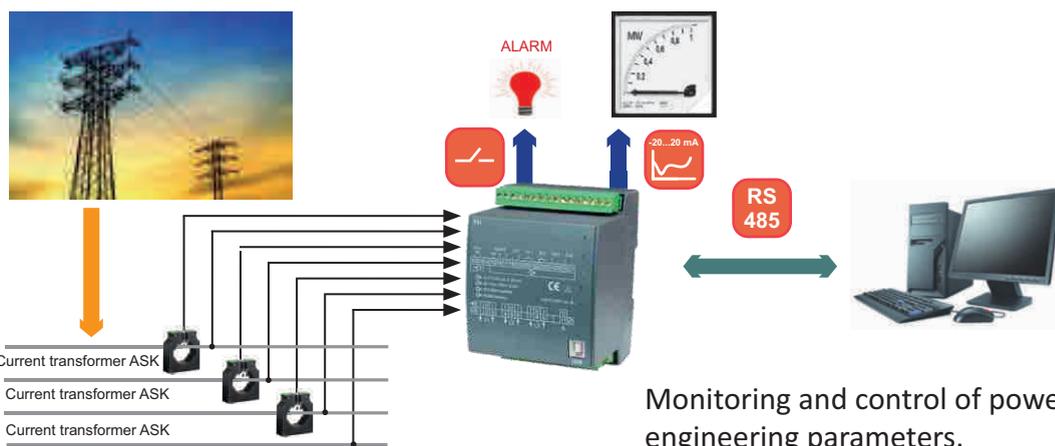

Measured Quantities and Measuring Ranges

Measured value	Measuring range	L1	L2	L3	Σ	Basic error
Current 1/5A L1...L3	0.02...6 A a.c.*	●	●	●		±0.2%
Voltage L-N	2.9...276 V a.c.*	●	●	●		±0.2%
Voltage L-L	10...480 V a.c.*	●	●	●		±0.5%
Frequency	47.0...63.0 Hz	●	●	●		±0.2%
Active power	-1.65 kW...1.4 W...1.65 kW*	●	●	●	●	±0.5%
Reactive power	-1.65 kvar...1.4 var...1.65 kvar*	●	●	●	●	±0.5%
Apparent power	1.4 VA...1.65 kVA*	●	●	●	●	±0.5%
Tangens	-1.2...0...1.2	●	●	●	●	±1%
Power factor PF	-1...0...1	●	●	●	●	±0.5%
Input active energy	0 .. 99 999 999.9 kWh*				●	±0.5%
Output active energy	0 .. 99 999 999.9 kWh*				●	±0.5%
Inductive reactive energy	0...99 999 999.9 kvarh*				●	±0.5%
Capacitive reactive energy	0...99 999 999.9 kvarh*				●	±0.5%
THD	0...100%	●	●	●		5%

* - for ratio Ki=Ku=1. Current ratio Ki programmable in the range 1...1000. Voltage ratio Ku programmable in the range 1...4000

Outputs

Type of output	Properties
Relay output	0, 2 or 4 relays, voltageless NO contacts, load: 250 V a.c./ 0.5 A a.c.
Impulse energy output	O/C passive, acc. to EN 62053-31, impuls constant: 5000..20000 imp/kWh programmable, independent on Ki, Ku ratio settings
Analog output	0, 2 or 4 programmable outputs: -20...0..20 mA, R _{load} = 0...250 Ω, accuracy 0.2%

Digital Interface

Type of interface	Transmission protocol	Mode	Rate
RS-485 Modbus	MODBUS RTU	8N2, 8E1, 8O1, 8N1	4.8; 9.6; 19.2; kbit/s
USB 1.1/ 2.0	MODBUS RTU	8N2	9.6 kbit/s

Sifam Tinsley Instrumentation Ltd
Unit 1 Warner Drive,
Springwood Industrial Estate
Braintree, Essex, UK, CM72YW
E-mail: sales@sifamtinsley.com
Web: www.sifamtinsley.com/uk
Contact: +44(0)1803615139



Sifam Tinsley Instrumentation Inc.
3105, Creekside Village Drive,
Suite No. 801, Kennesaw,
Georgia 30144 (USA)
E-mail Id : psk@sifamtinsley.com
Web : www.sifamtinsley.com
Contact No. : +1 404 736 4903

External Features

Overall dimensions	96 x 120 x 100 mm	fixing on a 35mm DIN rail
Weight	0.3 kg	
Protection grade	for casing: IP40	for terminals: IP10

Rated Operating Conditions

Supply voltage	85 .. 253 V a.c. , 40 .. 400 Hz, 90 .. 320 V d.c. or 20 .. 40 V a.c., 40 .. 400 Hz, 20 .. 60 V d.c.	Power input ≤ 6 VA
Power input	in voltage circuit ≤ 0.05 VA	in current circuit ≤ 0.05 VA
Input signal	<ul style="list-style-type: none"> 0 .. 0.005 .. 1.2In; 0.05 .. 1.2 Un for measurement of current and voltage; 0 .. 0.1 .. 1.2In; 0 .. 0.1 .. 1.2Un for measurement of coefficients Pf_i, $tg\phi_i$ 	<ul style="list-style-type: none"> signal frequency 47 .. 63 Hz sinusoidal signal (THD ≤ 8%)
Power factor	-1 .. 0 .. 1	
Analog outputs	-24 .. -20 .. 0 .. 20 .. 24 mA	
Temperature	ambient: -10...23...55°C	storage: -30...70°C
Humidity	25 .. 95%	inadmissible condensation
Additional error (in % of the intrinsic error)	from output signals frequency < 50%	from ambient temperature changes < 50%/ 10%
Operating position	any	
External magnetic field	0 .. 400 A/m	
Short duration overload (5 s)	voltage input: 2 Un (max. 1000 V)	current input: 10 In
Admissible peak factor	current intensity: 2	voltage: 2

Safety and Compatibility Requirements

Electromagnetic compatibility	noise immunity	acc. to EN 61000-6-2
	noise emissions	acc. to EN 61000-6-4
Isolation between circuits	basic	acc. to EN 61010-1
Pollution level	2	
Installation category	III	acc. to EN 61010-1
Maximal phase-to-earth voltage	300 V	
Altitude a.s.l.	< 2000 m	

Additional Errors in % The Intrinsic Error

From frequency of input signals	< 50%
From ambient temperature changes	< 50%/ 10%
For THD > 8%	< 100%

Connection Diagram

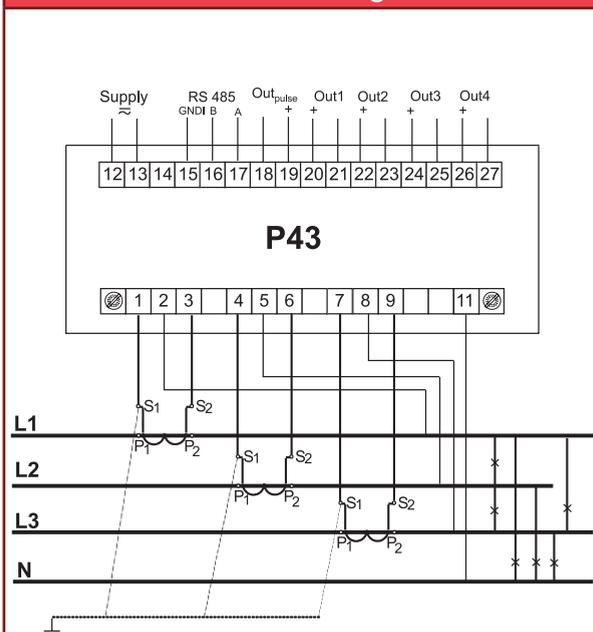


Fig. 1 Exemplary connection diagram for 4-wire network.

Ordering

P43 -	X	X	X	X	XX	X	X
Current input In:							
1 A (X/1)	1						
5 A (X/5)	2						
Voltage input (phase/phase-to-phase) Un:							
3 x 57.7/100 V	1						
3 x 230/400 V	2						
Supply voltage:							
85..253 V a.c., 90..320 V d.c.	1						
20..40 V a.c., 20..60 V d.c.	2						
Output type:							
without analog outputs, 4 relays	1						
2 analog outputs, 2 relays	2						
4 analog outputs, without relays	3						
Version:							
standard					00		
custom-made*					XX		
Language:							
Polish						P	
English						E	
other						X	
Acceptance tests:							
without extra quality requirements							0
with an extra quality inspection certificate							1
acc. to customer's requirements*							X

* version code will be established by the manufacturer

Example of order:

The code: **P43 - 2 2 1 3 00 E 7** means:

- P43** - transducer of P43 type
- 2** - input current: 5 A
- 2** - input voltage: 3 x 230/400 V
- 1** - supply voltage: 85..253 V a.c., 90..320 V d.c.
- 3** - 4 analog outputs, without relays
- 00** - standard version
- E** - English language
- 7** - with an extra quality inspection certificate.

See Also



Current transformers.



Analysers of network parameters ND1.



Meter of network parameters N13.



For more information about SIFAM's products please visit our website www.sifamtinsley.com/uk

Sifam Tinsley Instrumentation Ltd
Unit 1 Warner Drive,
Springwood Industrial Estate
Braithwaite, Essex, UK, CM72YW
E-mail: sales@sifamtinsley.com
Web: www.sifamtinsley.com/uk
Contact: +44(0)1803615139



Sifam Tinsley Instrumentation Inc.
3105, Creekside Village Drive,
Suite No. 801, Kennesaw,
Georgia 30144 (USA)
E-mail Id: psk@sifamtinsley.com
Web: www.sifamtinsley.com
Contact No.: +1 404 736 4903