SAFETY ORGANIZATIONS

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET:

UL RECOGNIZED: UL 1283 CSA CERTIFIED: CSA C22.2 No. 8 VDE APPROVED: EN 60939-2

OPERATING SPECIFICATIONS

20 AMP, 120/250 VAC, 16 AMP/40°C, 250 VAC LINE CURRENT/VOLTAGE: 20

LINE FREQUENCY:

50~60Hz

MAXIMUM LEAKAGE CURRENT, EACH LINE TO GROUND:

@ 120V 60Hz 0.04mA

0.07mA @ 250V 50Hz

OPERATING AMBIENT TEMP. RANGE: -10°C TO +40°C @ RATED CURRENT, In.

RELIABILITY SPECIFICATIONS:

STORAGE TEMPERATURE: -40°C TO +85°C HUMIDITY: 21 DAYS € 40°C 95% RH. CURRENT OVERLOAD TEST: 6 TIMES In FOR

CUSTOMER DRAWING CATALOG # 20SRB1-W ECN# DATE PPRVD 15-000476 TAM 190CT15

TEST SPECIFICATIONS:

INDUCTANCE: N/A CAPACITANCE: (MEASURED @ 1KHz, 0.250VAC MAX., 25°C±1°C)

LINE TO GROWND:

470 pF±20%

LINE TO LINE:

NZA. μF ±20%

DISCHARGE RESISTOR: L/G AND L/L I.R.

WA Ma

NO DISCHARGE RESISTOR:

6000MA (MIN.) @ 100VDC,


20°C AND 50% RH

RECOMMENDED RECEIVING INSPECTION HIPOT:


1500 VAC FOR 1 MINUTE 1450 VOC FOR 1 MINUTE LINE TO GROUND: LINE TO LINE:

FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

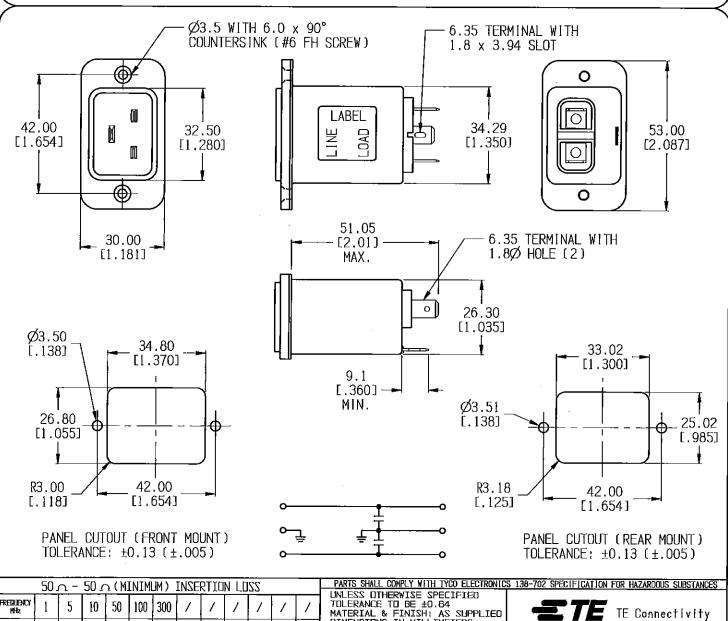

205FB1-V | .ckd

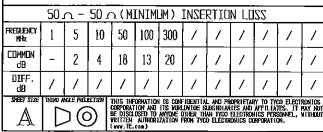

MATERIAL & FINISH: AS SUP DIMENSIONS IN MILLIMETERS NOTES:

POWER LINE FILTER

TE PART NO.: 5-1609152-4 MIE: 3/4

14AU614 ORY. BY: 20SRB1-W **CRIG** TAM

1